



City of Chicago



02015-8325

Office of the City Clerk

Document Tracking Sheet

Meeting Date: 11/18/2015

Sponsor(s): Arena (45)
Cappleman (46)
Moore (49)
Osterman (48)
Reboyras (30)
Napolitano (41)
Reilly (42)
Hairston (5)
Silverstein (50)
Sadlowski Garza (10)
Thompson (11)
Ramirez-Rosa (35)
Mell (33)
Santiago (31)
Hopkins (2)
Munoz (22)
Beale (9)
Cardenas (12)
Villegas (36)
Waguespack (32)
Taliaferro (29)
Dowell (3)
Moreno (1)
Lopez (15)

Type: Ordinance

Title: Amendment of Municipal Code Section 13-64-270
concerning carbon monoxide detector requirements for
Class B institutional and Class C assembly units

Committee(s) Assignment: Committee on Zoning, Landmarks and Building Standards

ORDINANCE

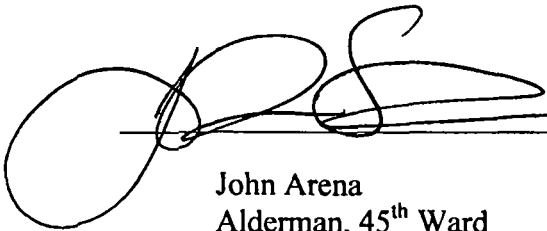
BE IT ORDAINED BY THE CITY COUNCIL OF THE CITY OF CHICAGO:

SECTION 1. Section 13-64-270 of the Municipal Code of Chicago is hereby amended by deleting the language struck through and adding the language underlined, as follows:



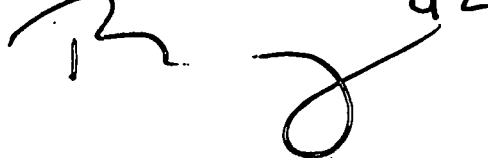
13-64-270 Carbon monoxide detectors – Location; Class B institutional and Class C assembly units.

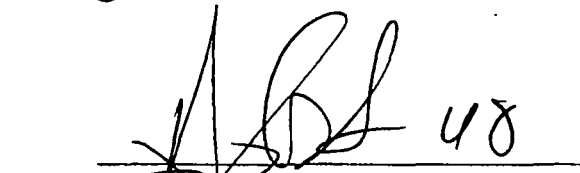


In every Class B institutional unit as defined in Sections 13-56-050 and 13-56-060 and in every Class C assembly unit as defined in Section 13-56-070, not less than one approved carbon monoxide detector shall be installed per every 10,000 square feet, or fraction thereof; (a) on every floor on which a fossil fuel-burning appliance, boiler or furnace is located, and (b) on every floor heated by any type of warm air heating plant as defined in Chapter 13-184* that burns fossil fuel., except that every school building heated with a boiler or fossil fuel-burning furnace shall have one approved carbon monoxide detector installed per every 10,000 square feet, or fraction thereof, on every floor, regardless of if there is a fossil fuel-burning appliance, boiler or furnace located on such floor. On every floor of a Class B institutional unit which contains sleeping quarters, one approved carbon monoxide detector shall also be installed within 15 feet of all rooms used for sleeping purposes that are either (a) located near a fossil fuel burning appliance, boiler or furnace or (b) heated by any type of warm air heating plant, as defined in chapter 13-184, which burns fossil fuel. Floor area shall be computed separately for each floor.

SECTION 2. This ordinance shall be in force and effect 30 days after passage and approval.


John Arena
Alderman, 45th Ward

 James Capplesman 46

 Frank A. You 49
 30
 42

 48
 4151
 Linda N. Hawton 5

Paul Jones 50

Luan Sakowski Dyer 10

Robert Hoop 11

Carl Daring 35

Paul Miller 23

Ally Sutz (31)

Ben Hahn 2

Al Miller 22

Anthony Buel 9th

John A. O'Connell

John 36

Scotty 32

Cliff Troy (29)

Pat Howell 34

Jack Munn 1 51

Raymond (3)